





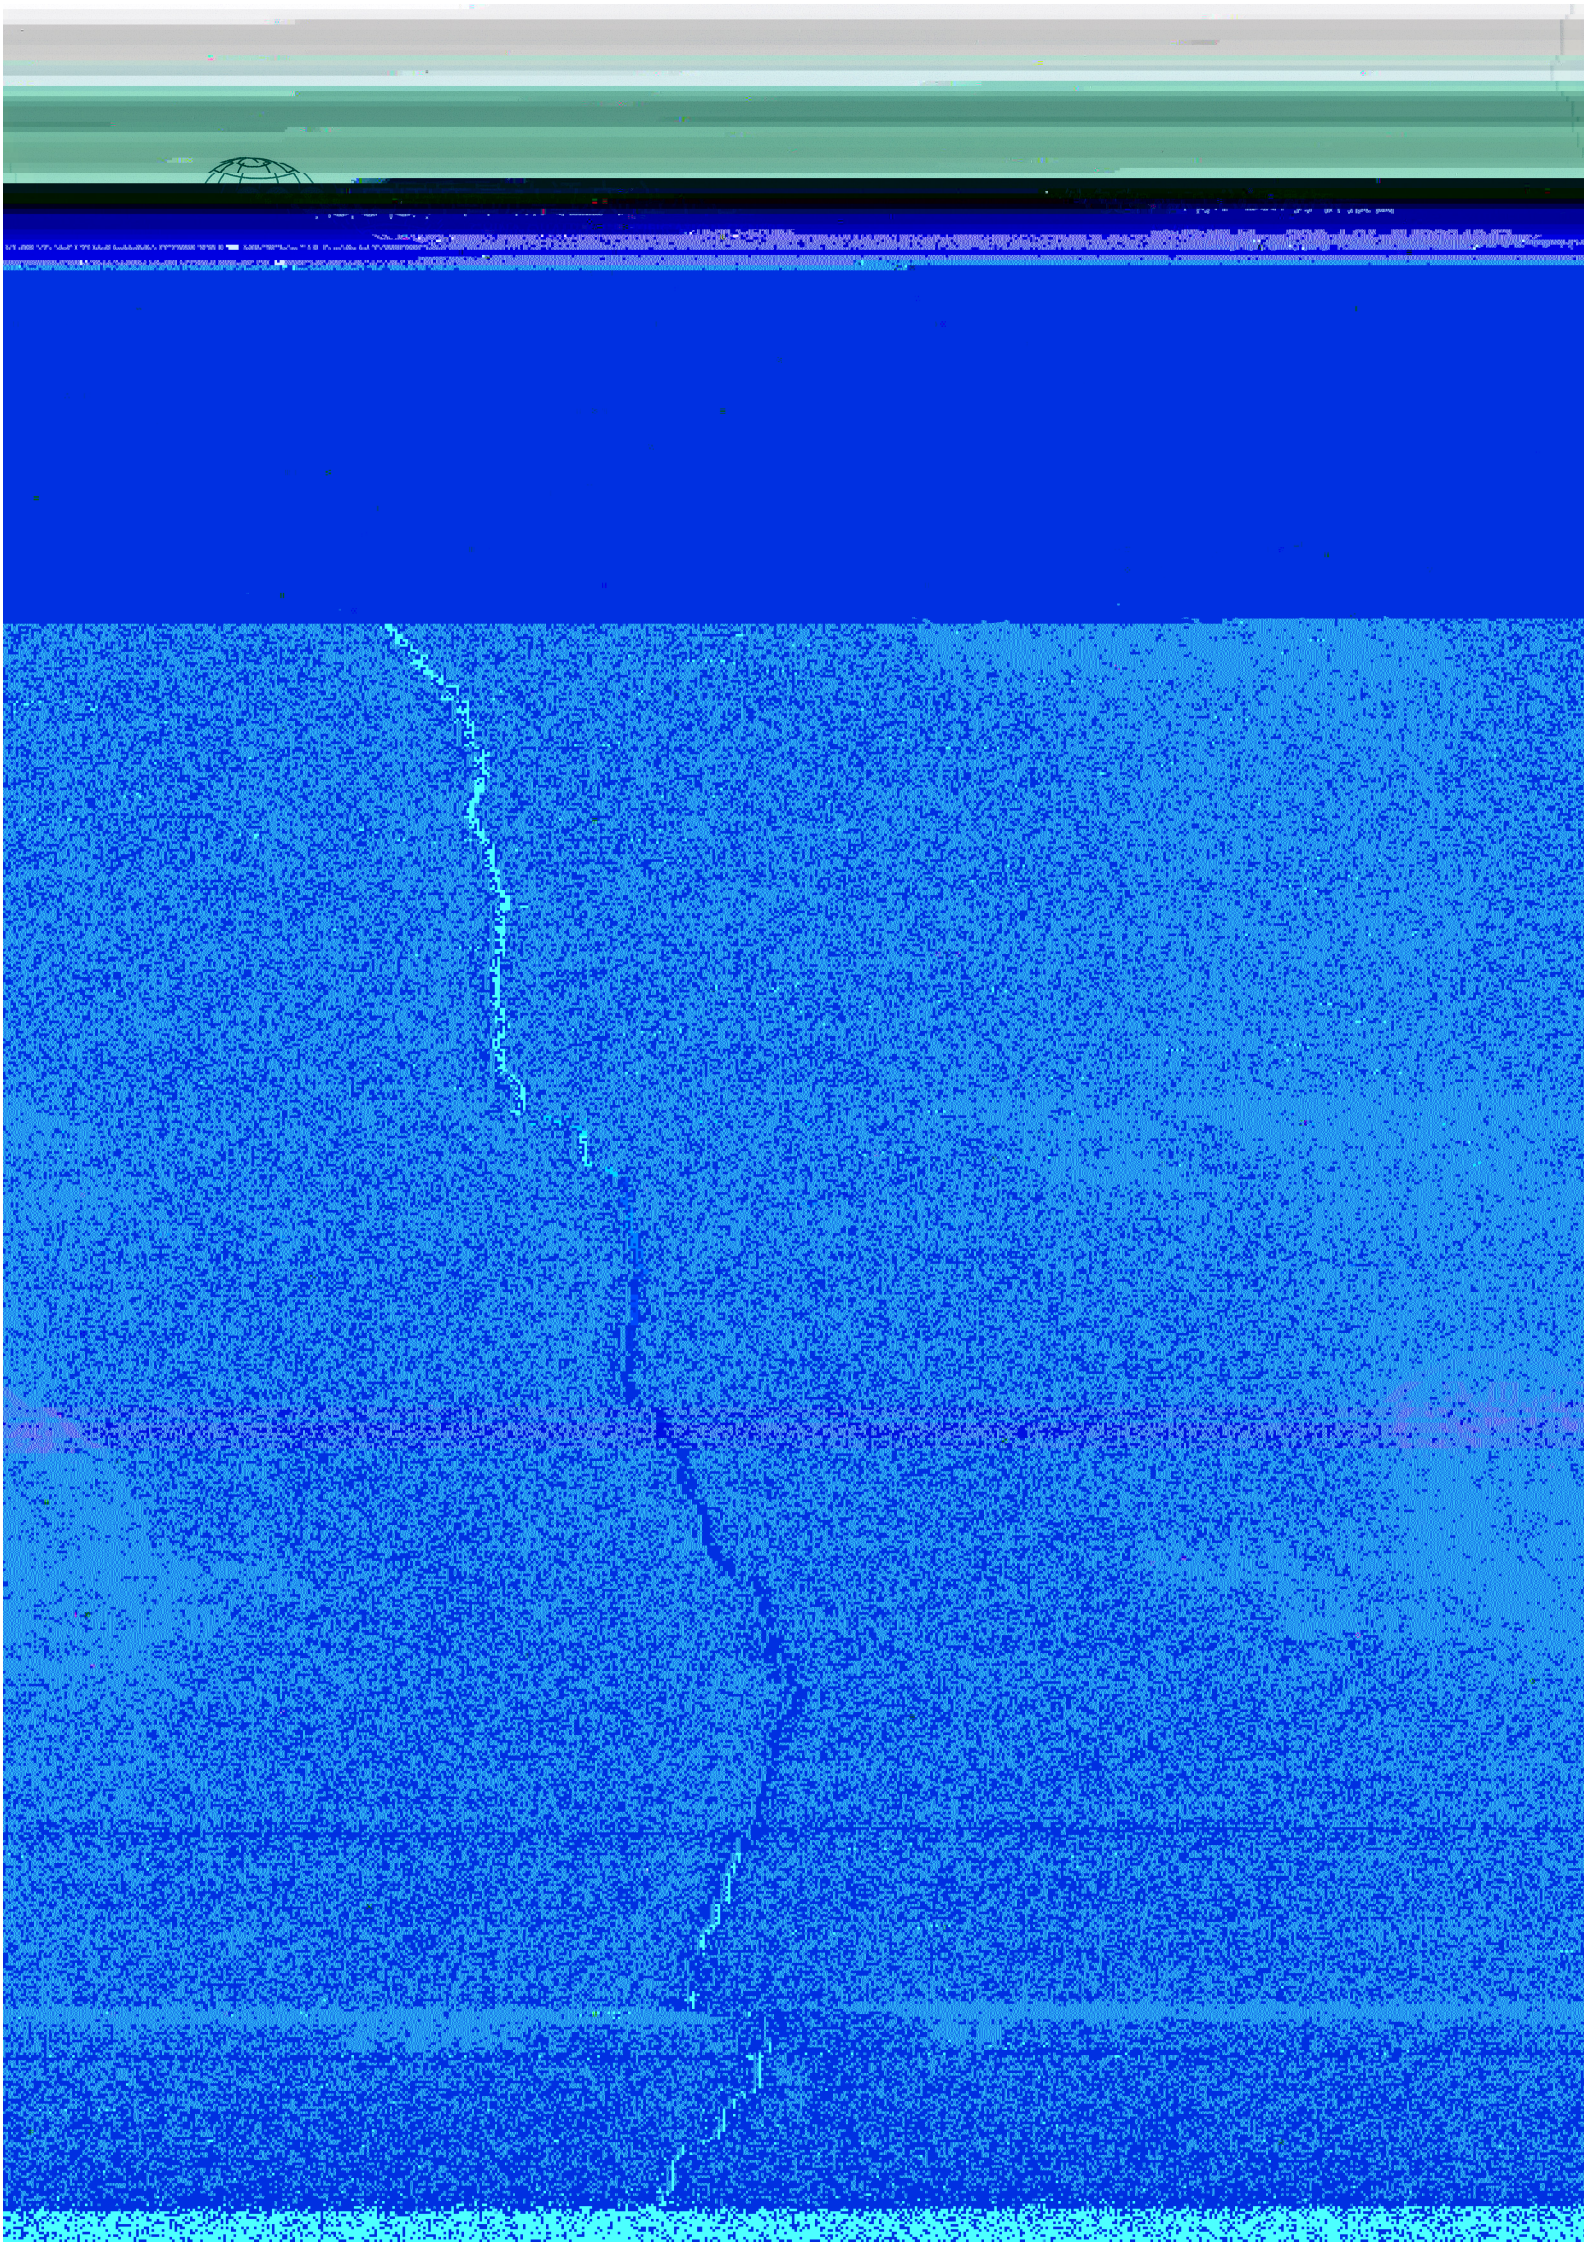

## 2.5

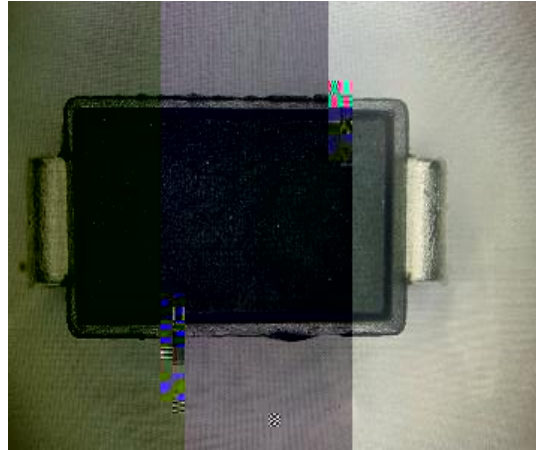

## 2.6

1

2

3

4

5

6



|   |  |  |
|---|--|--|
|   |  |  |
|   |  |  |
|   |  |  |
|   |  |  |
|   |  |  |
| / |  |  |

0.1%

4

|  |                           |
|--|---------------------------|
|  | ISO14067 PAS2050 IPCC     |
|  | GaBi ts 10.0.1.92<br>2022 |

5

|   |                     |  |
|---|---------------------|--|
|   | kgCO <sub>2</sub> e |  |
|   |                     |  |
|   |                     |  |
|   |                     |  |
|   |                     |  |
| / |                     |  |
|   | CO <sub>2</sub> e   |  |

6

